


## ELEVATION

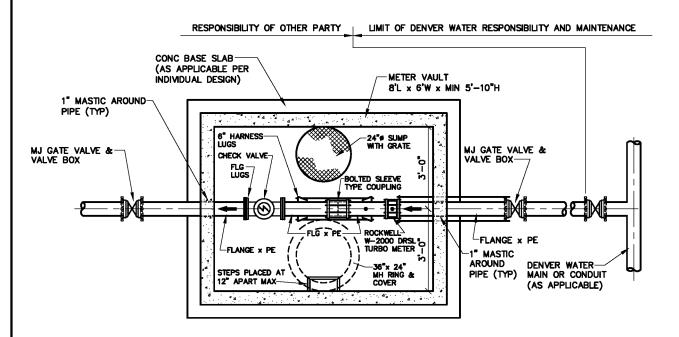

## PLAN

## NOTES:

- 1. METER VAULT DESIGN TO BE SUBMITTED AND APPROVED FOR EACH INDIVIDUAL INSTALLATION. DESIGN SHALL CONFORM TO DENVER WATER ENGINEERING STANDARDS LATEST REVISION.
- 2. THE DISTANCE BETWEEN RUNGS, CLEATS, AND STEPS SHALL NOT EXCEED 12 INCHES AND SHALL BE UNIFORM THROUGHOUT THE LENGTH OF THE LADDER.

DENVER WATER 1500 West 12th Avenue-Denver, Colorado 80204 Phone(303)628–8000 releccipler No.(303)628–808	is1
SINGLE FEED SYSTEM INTERCONNECTION	
Scale: _ <b>NONE</b>	Date:
Drawn: _ C.B.B Tr: .	Ck:
Approved: Alt Buling	Dr1 <u>2</u> 7_No <u>35</u> _

REVISED 2004

SHEET 80